Pneumatics

Rexroth **Bosch Group** 

# 4/4 controlled directional valve, directly operated, with electric position feedback and integrated electronics (OBE)

RE 29037/11.13 1/12 Replaces: 03.10

### Type 4WRPEH10

Size 10 Component series 2X Maximum operating pressure P, A, B 315 bar, T 250 bar Rated flow 50...100 l/min ( $\Delta p$  70 bar)



Type 4WRPEH10

### Table of contents


Contents	Page
Features	1
Ordering code	2
Function, section	3
Symbols	3
Test and service device	3
Technical data	4, 5
Electrical connection	6
Technical notes with regard to cable	6
Integrated electronics	7, 8
Characteristic curves	9, 10
Dimensions	11

#### Features

•	<ul> <li>Directly actuated controlled directional valve, with control spool and sleeve in servo quality</li> </ul>
	<ul> <li>Single-side operated, 4/4 fail-safe position in deactivated state</li> </ul>

- Electric position feedback and integrated electronics (OBE), calibrated in the factory
- Electric port 6P+PE Signal input of differential amplifier with interface A1 ±10 V or interface F1 4...20 mA ( $R_{\rm sh}$  = 200  $\Omega$ )
- Used for electro-hydraulic control systems in production and 6 test plants 7.8

### Ordering code

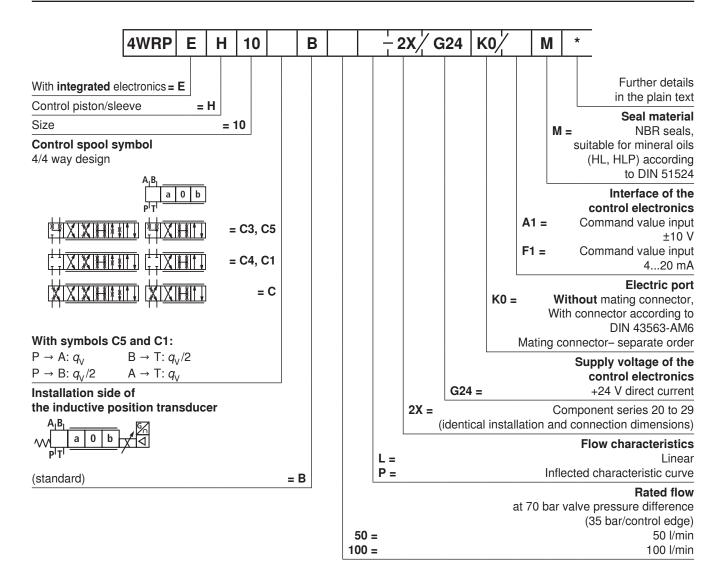

### Function, section

#### General


In the field of integrated electronics, the specified command value is compared with the actual position value. In case of deviations from the standard, the lifting solenoid is activated. Due to the changed magnetic force, the lifting solenoid adjusts the control valve against the spring.

Lifting/control cross-section are adjusted proportionally to the command value. In case of a command value provision of 0 V, the electronics adjusts the control valve against the spring to center position. In deactivated condition, the spring is unloaded to a maximum and the valve is in fail-safe position.

#### Switch-off behavior

If the electronics is switched off, the valve immediately moves to the secured basic position (fail safe).

In this process, the P-B/A-T position is passed which might cause movements at the controlled component. This must be taken into account when designing the plant.

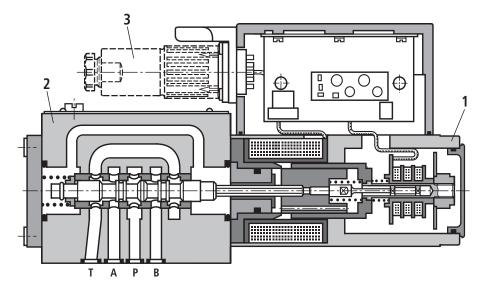

<sup>1</sup> Control solenoid with position transducer

- 2 Valve bodies
- 3 Mating connectors

### Symbols

$\begin{array}{c c} A_{1}B_{1} & \hline \\ & & \\ & & \\ & & \\ P^{T}T^{1} \end{array}$		L: Linear	P: Inflection 40 %
	C3, C5		
	C4, C1	Δs	
	С		

### Test and service device

- Service case Type VT-VETSY-1 with test device, see RE 29685

- Measuring adapter 6P+PE Type VT-PA-2, see RE 30068

### **Technical data**


general						
Туре			Gate value (	directly operated w	with steel sleeve	
Actuation			Gate valve, directly operated, with steel sleeve			
Type of connection			Proportional solenoid with position control, OBE			
Installation position			Plate port, porting pattern (ISO 4401-05-04-0-05)			
Ambient temperatu		°C	Any -20+50			
Weight		kg	7,1			
Vibration resistanc	e test condition		Max. 25 <i>g</i> , space vibration test in all directions (24 h)			
hydraulic (measur		$= 40 \circ C + 5 \circ C$				
Hydraulic fluid		511	Hydraulic oil according to DIN 51524535, other media upon request			
	Recommer	nded mm <sup>2</sup> /s	20100			
Viscosity range	Max admis					
Hydraulic fluid tem		°C	-20+70			
Maximum admissible degree of contamination of the hydraulic fluid cleanliness class according to ISO 4406 (c)			Class 18/16/	'13 <sup>1)</sup>		
Flow direction			According to	symbol		
Rated flow at $\Delta p = 35$ bar per ed	ge <sup>2)</sup>	l/min	50 (1:1)	50 (2:1)	100 (1:1)	100 (2:1)
Max operating	Port P, A, I	3 bar	315		·	·
pressure	Orifice T	bar	250			
Limitation of use $\Delta$ pressure loss at the		bar	315	315	160	160
$q_{\text{Vnom}}$ : > $q_{\text{N}}$ values	C4, C1	bar	250	250	100	100
Zero flow at 100 bar	Linear characteris curve L	stic cm <sup>3</sup> /min	< 1200	< 1200	< 1500	< 1000
	Inflected characte curve P	eristic cm <sup>3</sup> /min	< 600	< 500	< 600	< 600
Fail-safe position					·	
C Flow at ∆ <i>p</i> = 35 ba	r per edge	l/min	50	50	100	100
C3, C5		cm <sup>3</sup> /min	50 P–A			
Zero flow at 100 bar		cm <sup>3</sup> /min	70 P–B			
C3, C5		l/min	10100 A-T			
Flow at $\Delta p = 35$ bar per edge		l/min	1025 B-T			
C4, C1 cm <sup>3</sup> /min		50 P–A				
Zero flow at 100 bar     cm³/min       cm³/min     cm³/min       cm³/min     cm³/min       Reaching the fail-safe position     0 bar       100 bar		70 P–B				
		70 A-T				
		50 B-T				
		12 ms				
		16 ms				

<sup>1)</sup> The cleanliness classes specified for the components must be adhered to in hydraulic systems. Effective filtration prevents faults and at the same time increases the service life of the components. For the selection of the filters see www.boschrexroth.com/filter

<sup>2)</sup> Flow at different  $\Delta p = q_{\text{nom}} \cdot \sqrt{\frac{\Delta p_{\text{x}}}{35}}$ 


### **Technical data**

static / dynamic	
Hysteresis %	≦ 0,2
Manufacturing tolerance q <sub>max</sub> %	< 10
Actuating time for signal step 0100 % ms	≦ 25
Temperature drift	Zero shift < 1 % at $\Delta T$ = 40 °C
Zero compensation	ex factory ±1 %
electric, control electronics integrated in the va	lve
Relative duty cycle %	100 ED
Protection class	IP 65 according to DIN 40050 and IEC 14434/5
Port	Mating connector 6P+PE, DIN 43563
Supply voltage Terminal A: Terminal B: 0 V	$24 V = _{nom}$ min. 21 V = / max. 40 V = Ripple max. 2 V =
Max. power consumption	60 VA
Fuse protection, external	2.5 A <sub>F</sub>
Input, version A1 Terminal D: U <sub>E</sub> Terminal E:	Differential amplifier, $R_{i} = 100 \text{ k}\Omega$ 0±10 V 0 V
Input, version F1 Terminal D: I <sub>D-E</sub> Terminal E: I <sub>D-E</sub>	Load, $R_{\rm sh}$ = 200 $\Omega$ 4(12)20 mA Current loop $I_{\rm D-E}$ feedback
Max. voltage of the differential inputs almost 0 V	$ \begin{bmatrix} D \to B \\ E \to B \end{bmatrix} $ max. 18 V =
Test signal, version A1 Terminal F: U <sub>test</sub> Terminal C:	LVDT 0±10 V Reference 0 V
Test signal, version F1 Terminal F: $I_{F-C}$ Terminal C: $I_{F-C}$	LVDT signal 420 mA, at external load 200500 $\Omega$ max. 420 mA output Current loop $I_{\rm F-C}$ feedback
Protective earthing conductor and shielding	See pin assignment (CE-compliant installation)
Adjustment	Calibrated in the factory, see characteristic curve of the valve
Electromagnetic compatibility tested according to	EN 61000-6-2: 2005-08 EN 61000-6-3: 2007-01

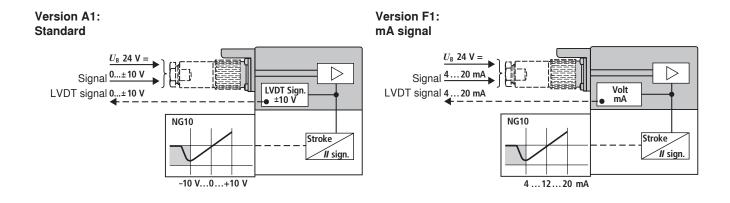

### **Electrical connection**

Electrical data, see page 5

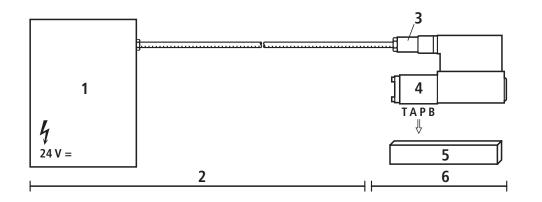

1 Control


- 2 On the customer side
- 3 Mating connector
- 4 Valve
- 5 Contact surface
- 6 On Rexroth side

## Technical notes with regard to cable

### **Integrated electronics**


### Block diagram/Pinout

Version A1: U<sub>D-E</sub> ±10 V

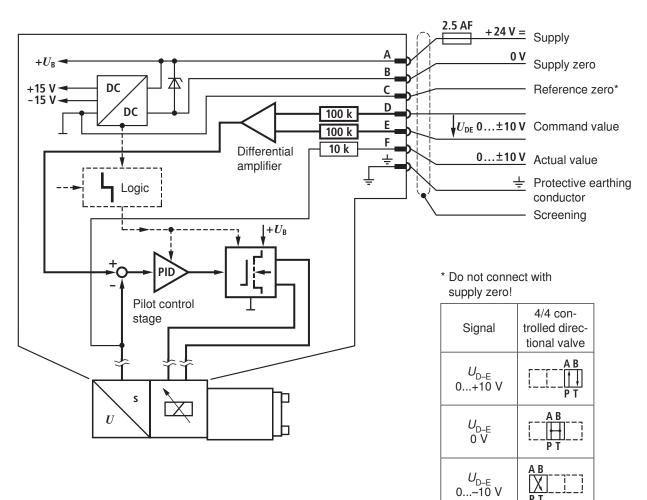

Pin assignment 6P+PE


Version A1:  $U_{D-E} \pm 10 \text{ V}$ ( $R_i = 100 \text{ k}\Omega$ )

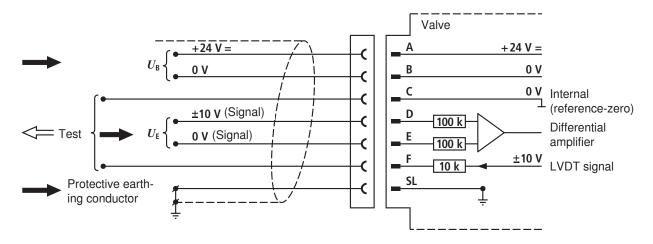

### Integrated electronics

### Block diagram/Pinout

Version F1: I<sub>D-E</sub> 4...12...20 mA

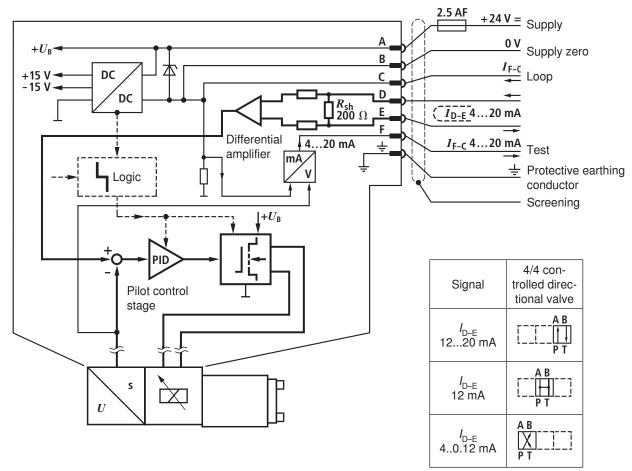


 $I_{D-E} \leq 2 \text{ mA: Valve inactive}$ 


#### Pin assignment 6P+PE Version F1: *I*<sub>D-E</sub> 4...12...20 mA $(R_{\rm sh} = 200 \ \Omega)$ Valve + 2<u>4 V =</u> +24V =Δ ( В <u>0 V</u> 0 V • **10** Ω С -( $R_{\rm sh} = 200 \ \Omega$ IN D -( <⊟ Test ¦ *I* = 4...20 mA OUT Ε • $R = 200 \ \Omega$ 4...20 mA F (max. 500 Ω) L • -LVDT signal Protective SL • earthing Ī conductor \_\_\_\_\_

## **Characteristic curves** (measured with HLP 46, $\vartheta_{oil} = 40 \text{ °C } \pm 5 \text{ °C}$ )

Flow – signal function	$q = f(U_{D-E})$
	$q = f(I_{D-E})$

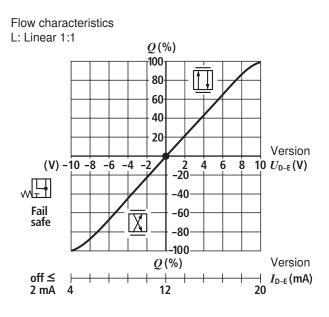

Flow characteristics P: (Inflection 40%) 1:1

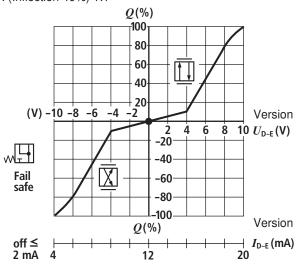


100 80 P-A 60 40 B-T 20 (V) -10 -8 -6 -4 -2 Version 2 -20 10 U<sub>D-E</sub> (V) 4 6 8 ᄴᅷᠲ -40 E Fail safe -60 X A٠ -80 -100 Version Q(%)off ≤ 2 mA  $I_{\text{D-E}}$  (mA) 20 12 4

Q(%)

Flow characteristics P: (Inflection 40%) 2:1


Flow characteristics


L: Linear 2:1




## **Characteristic curves** (measured with HLP 46, $\vartheta_{oil} = 40 \text{ °C } \pm 5 \text{ °C}$ )


### Pressure gain



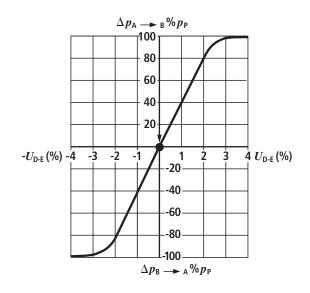


#### Bode diagram

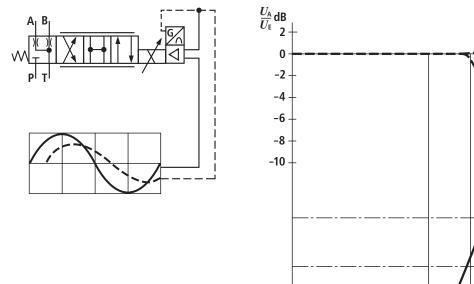

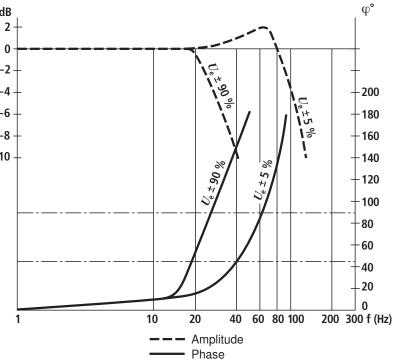


### **Dimensions** (dimensions in mm)

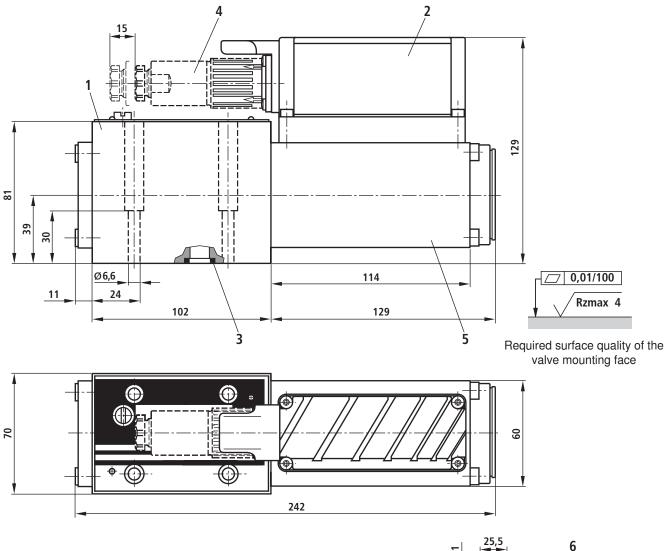

- 1 Valve housing
- 2 Integrated electronics
- 3 O-rings Ø 12x2 (ports P, A, B, T, T1)
- 4 Mating connector see technical data sheet RE 08008 (separate order)
- 5 Control solenoids with position transducer
- 6 Machined valve mounting face, porting pattern according to ISO 4401-05-04-0-05 Deviating from the standard: Ports P, A, B, T, T1 Ø 10.5 mm

**Subplates**, see data sheet 45055 (separate order)



Valve mounting screws (separate order) The following valve mounting screws are recommended: 4 hexagon socket head cap screws ISO 4762-M6x40-10.9-N67F82170 (galvanized according to N67F82170) Tightening torque  $M_A = 11+3$  Nm Mat. no. 2910151209 or 4 hexagon socket head cap screws ISO 4762-M6x40-10

4 hexagon socket head cap screws ISO 4762-M6x40-10.9 (friction rate  $\mu_{\text{total}}$  = 0.12-0.17)

Bosch Rexroth AG Hydraulics Zum Eisengießer 1 97816 Lohr am Main, Germany Phone +49 (0) 93 52 / 18-0 documentation@boschrexroth.de www.boschrexroth.de © This document, as well as the data, specifications and other information set forth in it, are the exclusive property of Bosch Rexroth AG. It may not be reproduced or given to third parties without its consent. The data specified above only serve to describe the product. No statements concerning a certain condition or suitability for a certain application can be derived from our information. The information given does not release the user from the obligation of own judgment and verification. It must be remembered that our products are subject to a natural process of wear and aging.